


DESCRIPTION OF PROJECT:
TO REPLACE EXISTING DIRECT

TRENCHING WILL BE REQUIRED (IN GREEN) BEFORE COMPLETING INSTALLATION OF NEW CABLE IN CONDUIT (IN RED)

EXISTING CABLE IN CONDUIT (IN ORANGE) WILL NOT BE REPLACED OR EFFECTED IN THIS PROJECT.

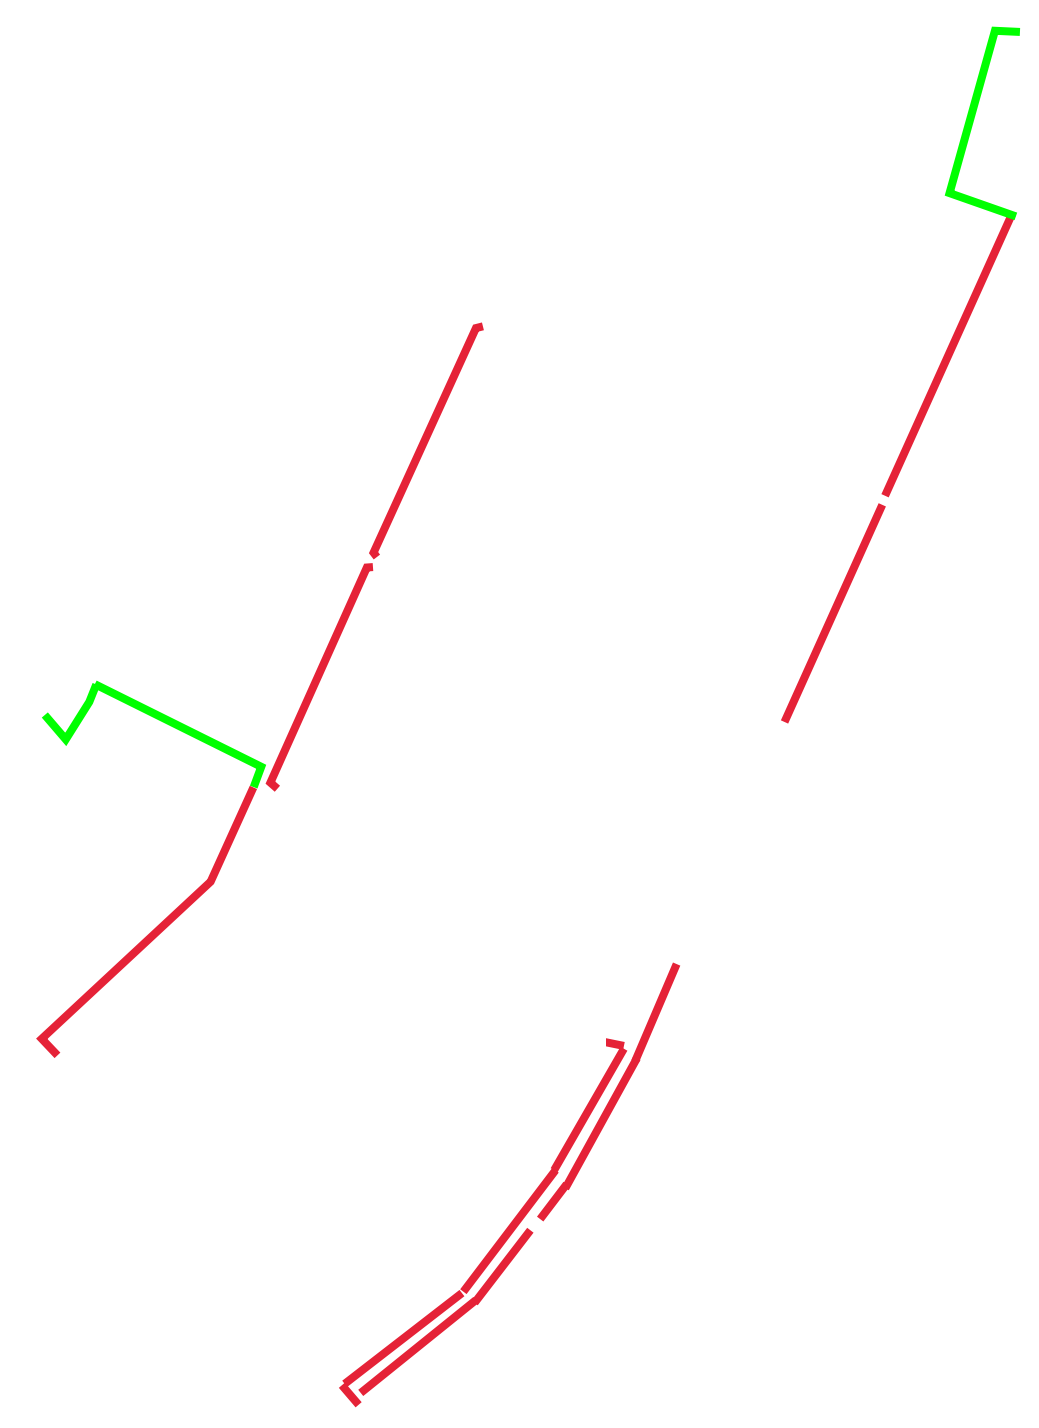

UPDATED: 12-2-2020